

Exhibit 1a: SEW infrastructure responsibility – Sewerage infrastructure diagrams

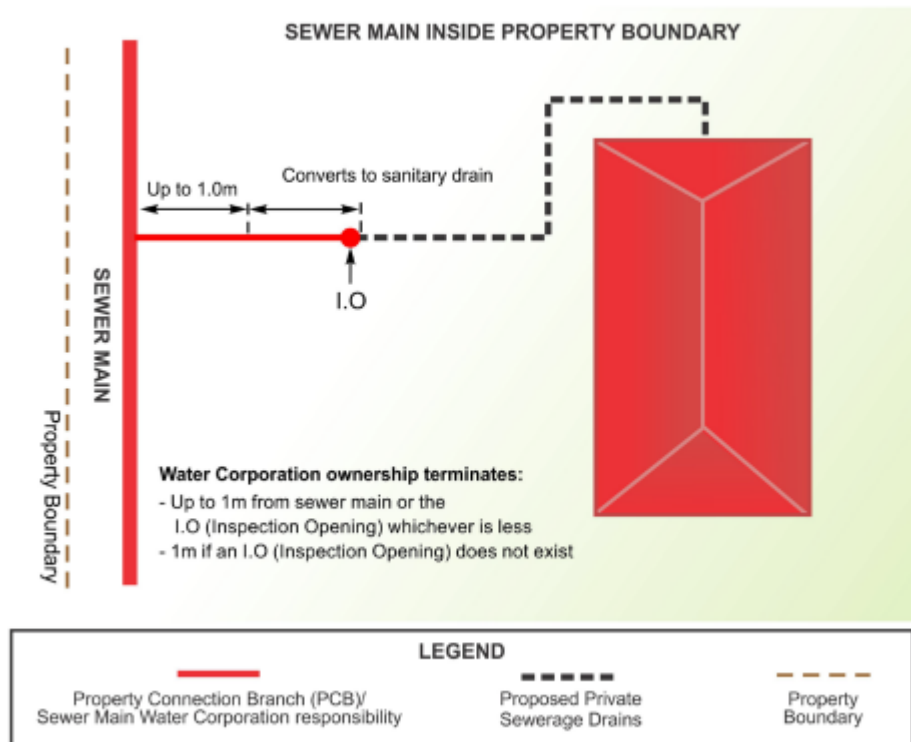


Figure 1 - Responsibility for sewer infrastructure when mains are located inside property boundary


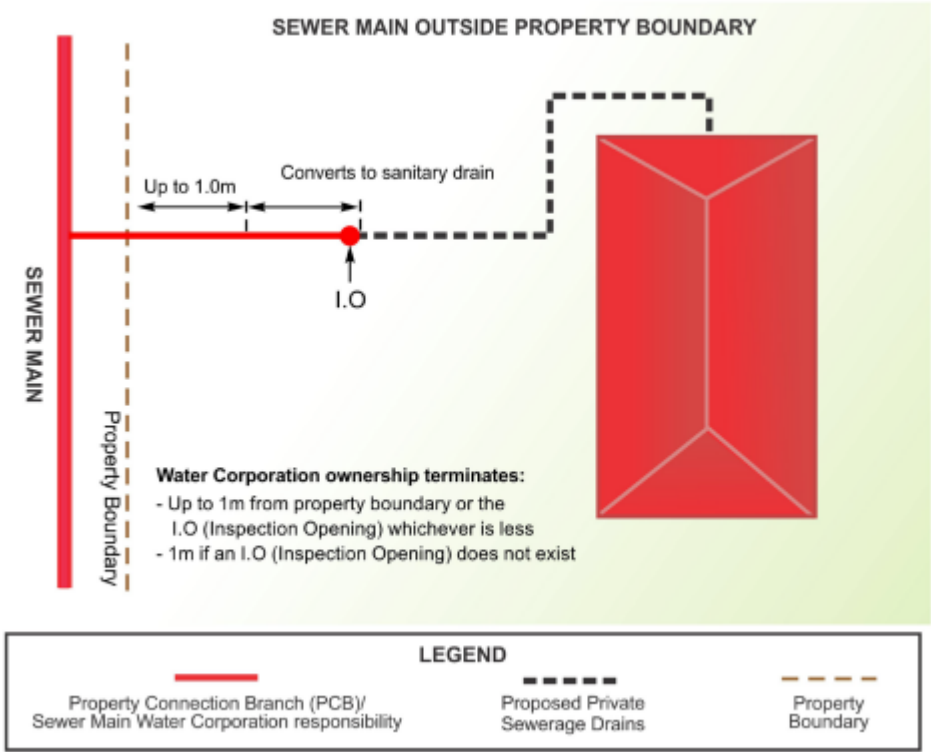


Figure 2 - Responsibility for sewer infrastructure when mains are outside property boundary

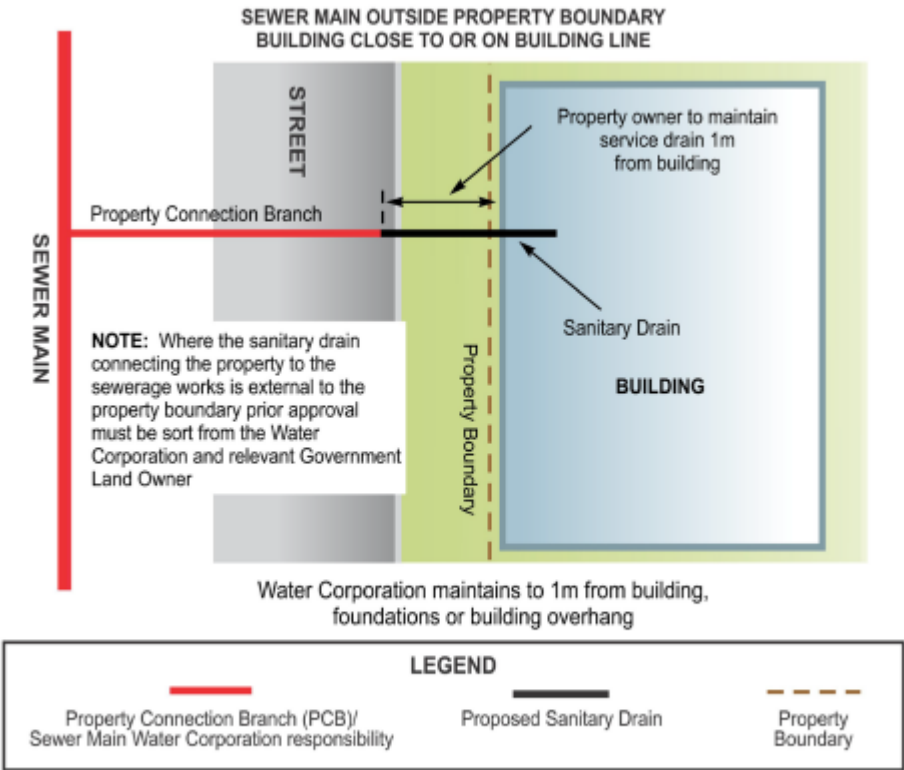

NOTE: Build Over clearances are applicable; refer to Customer Guide for required clearances

Figure 3 - Responsibility for sewer infrastructure where building is close to or on property line

Exhibit 1b: SEW infrastructure responsibility – Water infrastructure diagrams


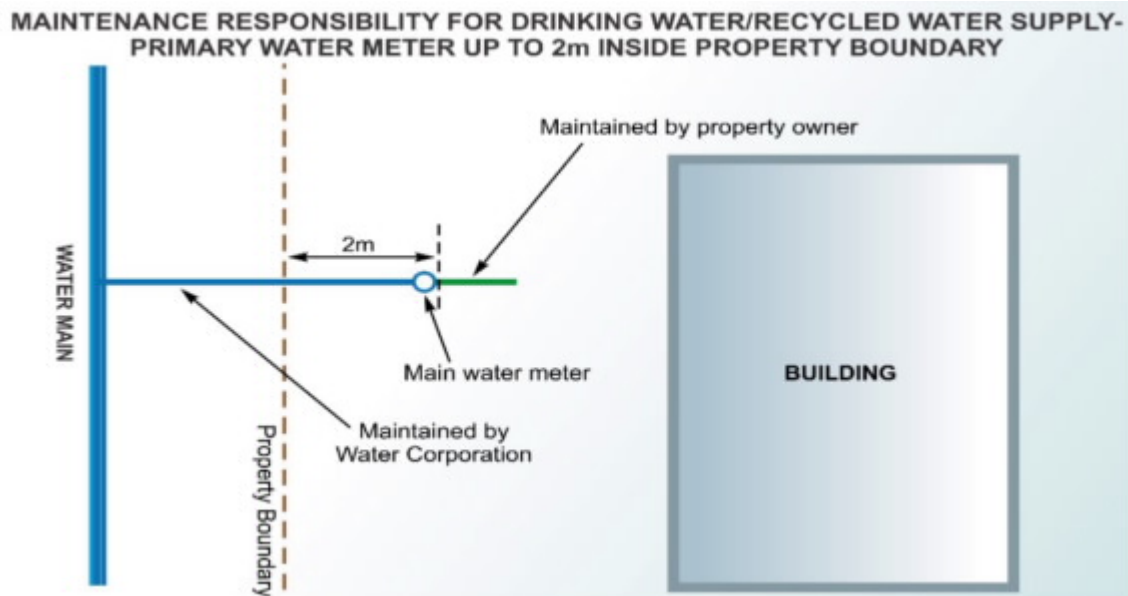



Figure 4 - Responsibility for water main, connecting pipe and meter when the meter is up to 2m inside property boundary

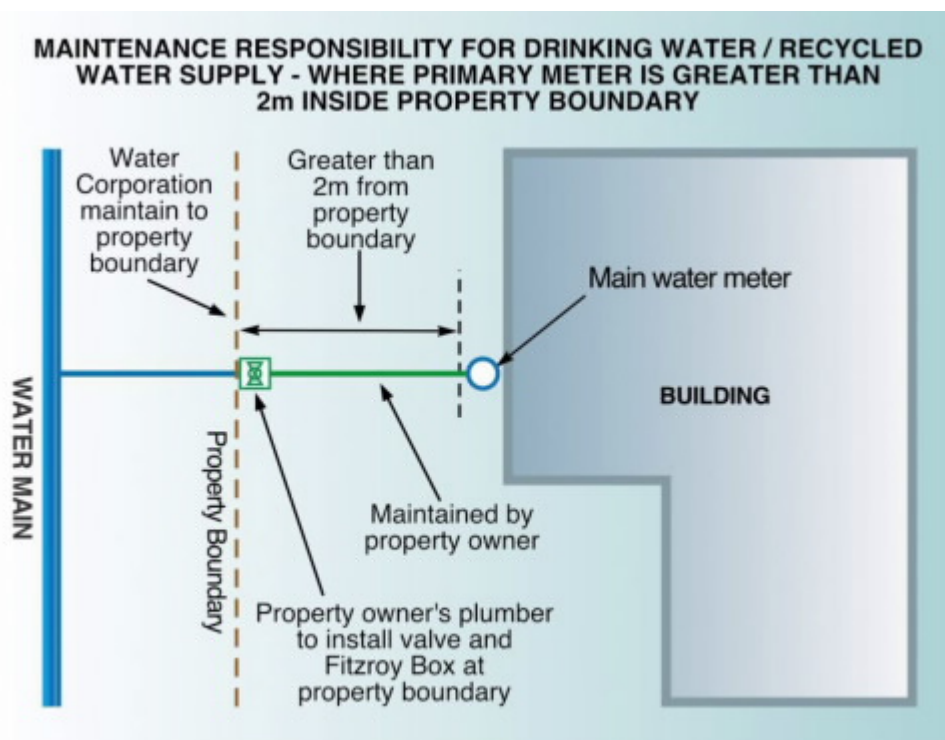

Water authority approval is required before a main water meter can be greater than 2 meters from property boundary.

Figure 5 - Responsibility for water main, connecting pipe and meter when the meter is greater than 2m inside property boundary

**MAINTENANCE RESPONSIBILITY FOR DRINKING WATER/RECYCLED
WATER SUPPLY - NO MAIN METER OR MAIN METER IS
LOCATED WITHIN A STRUCTURE**

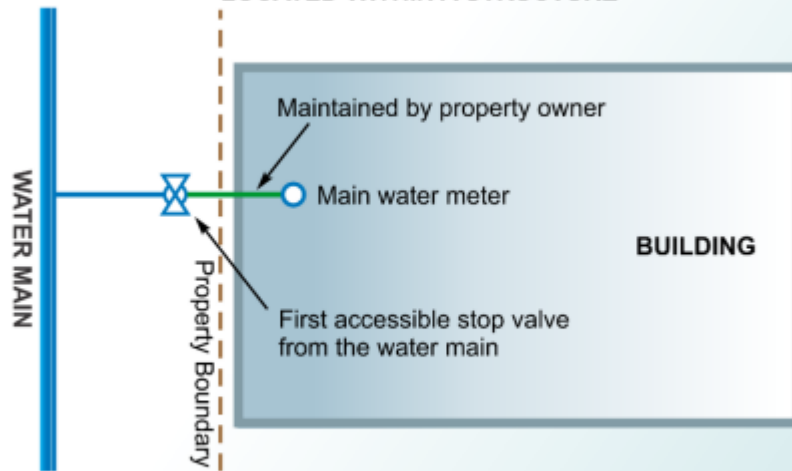

Water Corporation to maintain to the first accessible stop valve from the water main.
If a meter assembly stop valve is not accessible at all times, or where the
main water meter or any part of the property service pipe is located
within or beneath the walls of a structure

Figure 6 - Responsibility for water mains, connecting pipe and meter when the meter is located within a structure